



NOTES


1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. FILL MATERIAL OR GRAVEL BACKFILL SHALL BE PLACED IN 300mm LAYERS AND BE THOROUGHLY COMPACTED WITH 3 PASSES OF VIBRATORY COMPACTOR FOR EACH LAYER TO MINIMUM OF 95 % M.M.D.D.

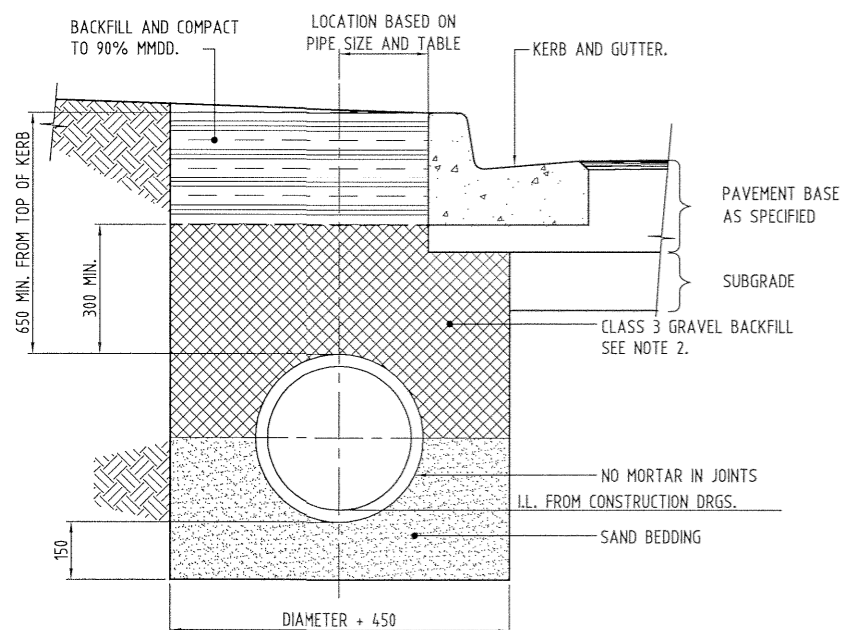

NORMAL DETAIL
(375 - 825 DIA.)

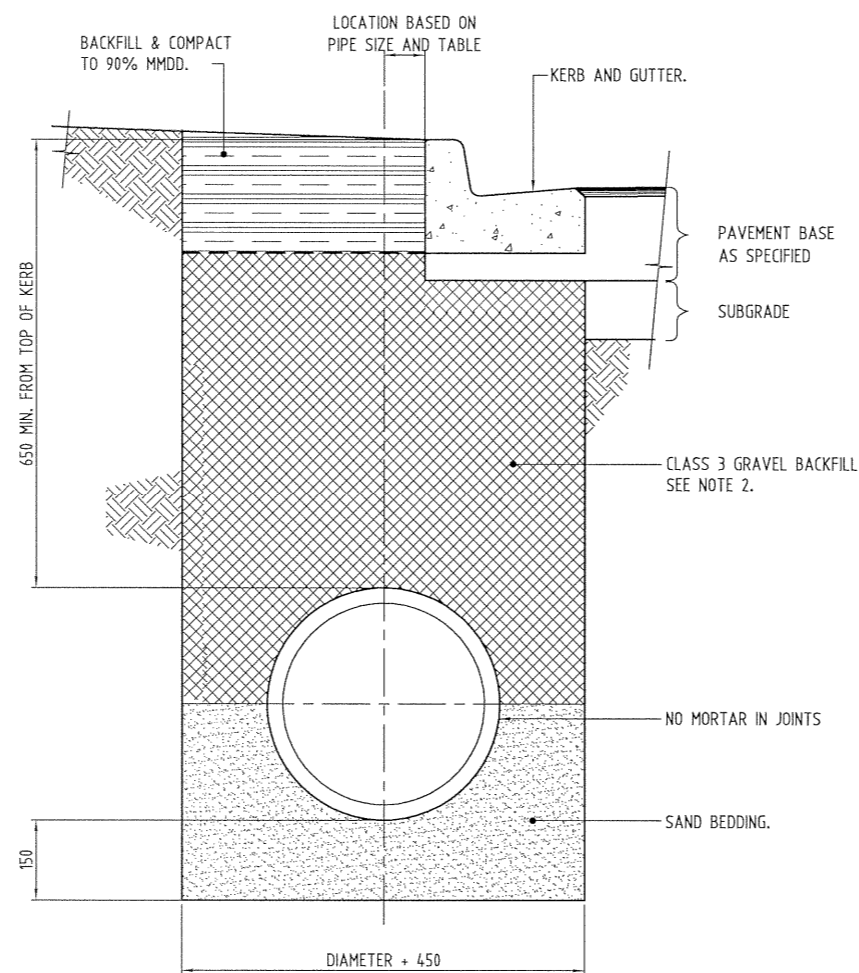


DEEP PIPE DETAIL
(375 - 825 DIA.)

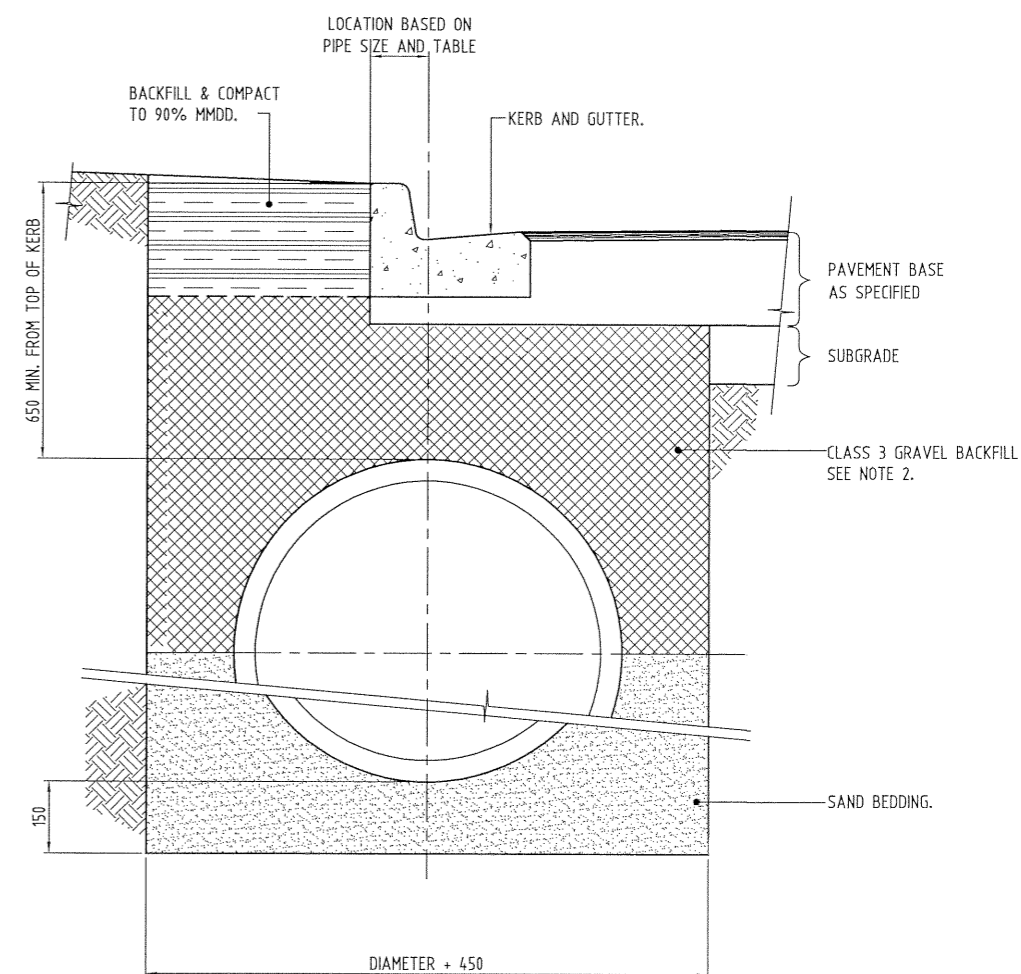

LARGE PIPE DETAIL
(900 DIA UPWARDS)

STANDARD PIPE LAYING DETAILS - TYPE 1



AMENDMENTS				APPROVED BY DIRECTOR TECHNICAL SERVICES	STANDARD DRAWING		
No.	DESCRIPTION	DATE	INITIAL		STANDARD PIPE LAYING - TYPE 1		
E				 Brendan Dowd Date 22/9/03	SHEET SIZE. A1	AMENDT. A	DRAWING No. DCC-105
D							
C							
B							
A	ORIGINAL ISSUE	09/03	S.W.S.		SHEET 6 OF 19		

