


SLOPING INLET HEADWALL

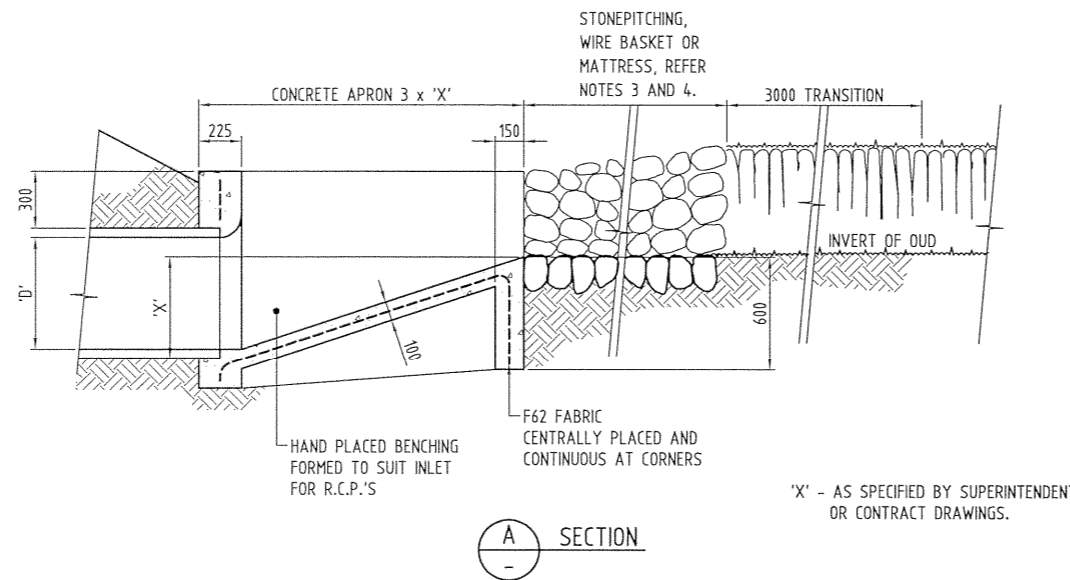


CONCRETE ENDWALL TYPE 3

FOR USE WITH R.C.P. OR R.C.B.C.

NOTES

1. ENDWALL TYPE. REFER TO CONTRACT DRAWINGS FOR TYPE AND SIZE.
2. GENERAL. ALL STRUCTURES DETAILED ON THIS DRAWING TO CONFORM TO TECHNICAL SPECIFICATION FOR ROADWORKS.
3. STONEPITCHING. SHALL BE INCORPORATED AS SHOWN ON CONTRACT DRAWINGS. ROCK SHALL BE APPROVED AND HAVE NO DIMENSIONS LESS THAN 200mm. STONEPITCHING SHALL BE NO LESS THAN 200mm THICK AND LAID IN ACCORDANCE WITH THE TECHNICAL SPECIFICATION FOR ROADWORKS.
4. WIRE BASKET OR MATTRESS. SHALL BE INCORPORATED WHERE SPECIFIED ON CONTRACT DRAWINGS.
5. CONCRETE. SHALL BE CLASS N25 AND PLACED IN ACCORDANCE WITH SPECIFICATION. FOR ANY PATCHING OR JOINTING USE MORTAR MIXED WITH LOKCRETE OR SIMILAR.
6. PREFABRICATED TYPE END WALLS. WILL REQUIRE APPROVAL PRIOR TO USE.



AMENDMENTS				APPROVED BY DIRECTOR TECHNICAL SERVICES <i>Brendan Dowd</i> Brendan Dowd Date 22/9/03	STANDARD DRAWING	
No.	DESCRIPTION	DATE	INITIAL		CONCRETE ENDWALL - TYPE 3	
E				SHEET 18 OF 19	SHEET SIZE. A1	AMENDT. A
D						
C						
B						
A	ORIGINAL ISSUE	09/03	S.W.S.			

